

## ZoneTight™, 3-way, Sweat

- For closed cold and warm water systems
- For switching functions and 2-point controls on the water side of air-handling units and heating systems
- Snap-assembly of the actuator







#### Type overview

Туре	DN
Z3075QS-J	20

### **Technical data**

Functional data	Valve size [mm]	0.75" [20]		
	Fluid	chilled or hot water, up to 60% glycol		
	Fluid Temp Range (water)	36212°F [2100°C] 360 psi 40 psi 40kPa		
	Body Pressure Rating			
	Close-off pressure ∆ps			
	Differential pressure Δpmax			
	Flow characteristic	linear		
	Pipe connection	Sweat		
	Installation orientation	upright to horizontal (in relation to the stem)		
	Servicing	maintenance-free		
	Flow Pattern	3-way Diverting		
	Leakage rate	0%		
	Cv	4.6		
Materials	Valve body	forged brass		
	Stem	brass		
	Stem seal	EPDM O-ring		
	Seat	PTFE, O-Ring EPDM		
	O-ring	EPDM (lubricated)		
	Ball	chrome plated brass		
Suitable actuators	Non Fail-Safe	CQB(X)		
	Electrical fail-safe	CQKB(X)		

# Safety notes



WARNING: This product can expose you to lead which is known to the State of California to cause cancer and reproductive harm. For more information go to www.p65warnings.ca.gov
If temperature exceeds 212°F operating range due to a boiler control failure the valve will safely contain the hot water but manufacturers product warranty becomes invalid. Valve and actuator replacement is at the expense of others.




#### **Product features**

A	pplication	The QCV zone valves are suited for large commercial buildings where higher close-off and the ability to change flow is desired. Common applications include unit ventilators, fan coil units, VAV reheat coils, fin tube casing, radiant panels and duct coils. The valve fits in space restricted areas and can be assembled without the use of tools.	
Flow/Mounti	ng details		
Operat	ing mode	The change-over zone valve is adjusted by a by an on/off signal.	rotary actuator. The rotary actuator is controlled
Simple direct	mounting	Tool-free snap assembly.	
		The actuator can be plugged on the valve by must match the holes on the flange.	/ hand (Caution! Just vertical movements). Pins
		The mounting orientation in relation to the v two times)	valve can be selected in 180° increments. (Possible
stallation notes			

### Inst

Permissible installation orientation

The ball valve can be installed upright to horizontal. The ball valve may not be installed in a hanging position, i.e. with the stem pointing downwards.



Water quality requirements Belimo valves are regulating devices. For the valves to function correctly in the long term, they must be kept free from particle debris (e.g. welding beads during installation work). The installation of a suitable strainer is recommended.

> Servicing Ball valves and rotary actuators are maintenance-free.


> > Before any service work on the control element is carried out, it is essential to isolate the rotary actuator from the power supply (by unplugging the electrical cable if necessary). Any pumps in the part of the piping system concerned must also be switched off and the appropriate slide valves closed (allow all components to cool down first if necessary and always reduce the system pressure to ambient pressure level).

> > The system must not be returned to service until the ball valve and the rotary actuator have been correctly reassembled in accordance with the instructions and the pipeline has been refilled by professionally trained personnel.






Direction of flow in both directions possible. Flow direction

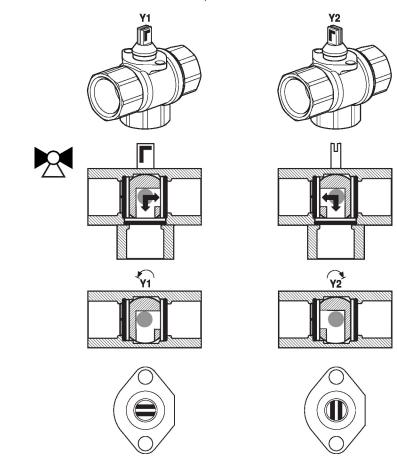

Flow setting At the actuator the end stop clip has to be removed in order to get the angle of rotation of 90°, which is needed for the change-over functionality.

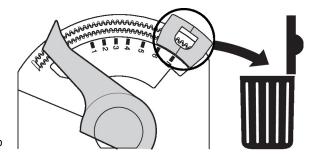


Remove end stop clip

# Dimensions

Туре	DN	Weight	
Z3075QS-J	20	1.1 lb [0.48 kg]	



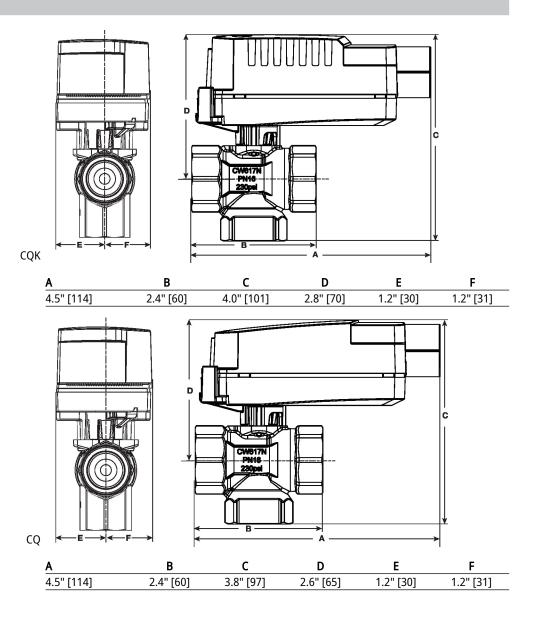



# On/Off, Electrical fail-safe, 24 V

- Nominal voltage AC/DC 24 V
- Control On/Off





# **Technical data**

Electrical data	Nominal voltage	AC/DC 24 V
	Nominal voltage frequency	50/60 Hz
	Nominal voltage range	AC 19.228.8 V / DC 21.628.8 V
	Power consumption in operation	2.5 W
	Power consumption in rest position	0.5 W
	Transformer sizing	5 VA
	Electrical Connection	22 GA plenum cable, 3 ft [1 m], with 1/2" NPT conduit connector
	Overload Protection	electronic thoughout 090° rotation
	Electrical Protection	actuators are double insulated
Functional data	Bridging time (PF)	2 s
	Pre-charging time	520 s
	Angle of rotation	90°
	Angle of rotation note	adjustable with mechanical stop
	Running Time (Motor)	75 s / 90°
	Running time fail-safe	<60 s
	Noise level, motor	35 dB(A)
	Noise level, fail-safe	35 dB(A)
	Position indication	pointer
Safety data	Power source UL	Class 2 Supply
	Degree of protection IEC/EN	IP40
	Degree of protection NEMA/UL	NEMA 2
	Enclosure	UL Enclosure Type 2
	Agency Listing	cULus acc. to UL60730-1A/-2-14, CAN/CSA E60730-1:02
		CE acc. to 2014/30/EU and 2014/35/EU
	Quality Standard	ISO 9001
	UL 2043 Compliant	Suitable for use in air plenums per Section 300.22(C) of the NEC and Section 602 of the IMC
	Ambient humidity	Max. 95% RH, non-condensing
	Ambient temperature	35104°F [240°C]
	Storage temperature	-40176°F [-4080°C]
	Servicing	maintenance-free
Weight	Weight	0.55 lb [0.25 kg]



Technical data sheet

CQKB24-LL

Technical data			
	Materials	Housing material	UL94-5VA
Product features			
	Application		off ZoneTight actuator. be done in accordance with the flow parameters and system ator is mounted directly to the valve without the need for tools or
		-	n response to AC/DC 24 V.
			ustable with the integrated mechanical stop.
Electrical installation			
Mining dia sugar-		observed. Actuators may also be po Actuators with plenum c Meets cULus requiremer <b>Warning! Live electrical c</b> During installation, testin to work with live electrication who has been properly t	ted in parallel. Power consumption and input impedance must be owered by DC 24 V. able do not have numbers; use color codes instead. Its without the need of an electrical ground connection. <b>omponents!</b> ng, servicing and troubleshooting of this product, it may be necessary al components. Have a qualified licensed electrician or other individual rained in handling live electrical components perform these tasks. rical safety precautions when exposed to live electrical components
Wiring diagrams AC 24 V Transformer Line Volts		Common Hot +	

Functions	Α	
0% 🞝	ጘ	<
100% 💐	\	(
Fail Position	100%	Open