
G225S, 2-Way, Globe Valve, Stainless Steel Trim







Total data	
Technical data	shilled or het water up to COO/ shool
Service	chilled or hot water, up to 60% glycol, steam
Flow Characteristic	linear
Controllable Flow Range	stem up - open A to AB
Size [mm]	1" [25]
End Fitting	NPT female ends
	hronze
Body	5101120
Stem	316 stainless steel
Stem Packing	spring loaded Teflon V-ring
Seat	316 stainless steel
Plug	316 stainless steel
Disc	Teflon
Body Pressure Rating [psi]	ANSI 250
ANSI Class	ANSI 250 (up to 400 psi below 150°F)
Max Inlet Pressure (Steam)	100 psi (690 kPa)
Media Temperature Range (Water)	20°F to 280°F [-7°C to 138°C]
Media Temperature Range (Steam)	32°F to 338°F [0°C to 170°C]
Maximum differential pressure (steam)	35 psi
Max Differential Pressure (Water)	35 psi (241 kPa)
Leakage	ANSI Class IV
Rangeability	75:1
Cv	14
Weight	3.1 lb [1.4 kg]
Servicing	Repack/Rebuild kits available

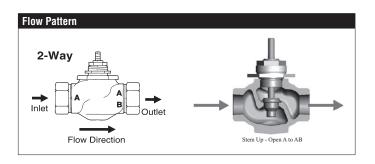


Application

This valve is typically used in Air handling units on heating or cooling coils, and fan coil unit heating or cooling coils. Some other common applications include Unit Ventilators, VAV box re-heat coils and bypass loops. This valve is suitable for use in hydronic system with variable flow. Bronze and stainless steel trim valves can be used for steam applications, depending on actuator and close-off combinations.

Suitable Actuators

	Non-Spring	Spring	Electronic Fail-Safe
G225S	25S SVB(X)	NFB(X)	SVKB(X)

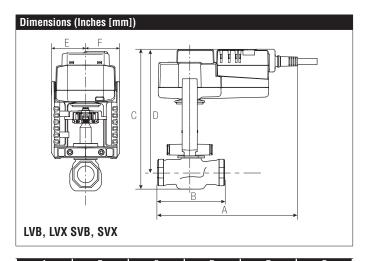



Α	В	C	D	E	F
8" [203]	4.65" [118]	9.5" [241]	8.35" [212]	1.95	" [49]

Piping

The valves should be mounted in a weather-protected area in a location that is within the ambient limits of the actuator. Allow sufficient room for valve with actuator and for service. The G2(S) and G3(D) preferred mounting position of the valve is with the valve stem vertical above the valve body, for maximum life. However, the assemblies can be mounted with the valve stem vertical or horizontal in relation to the pipe. The actuators should never be mounted underneath the valve, as condensation can build up and result in a failure of the actuators. Do not reverse flow direction.

G225S, 2-Way, Globe Valve, Stainless Steel Trim

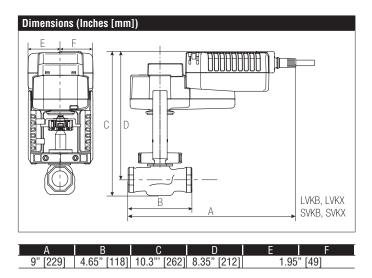

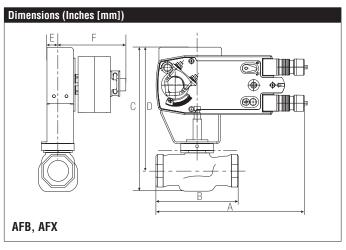

Modulating, Spring Return, 24 V, 0 to 135 Ω Input





24 VAC±20%, 50/60Hz, 24 VDC+20%/-10%
6.5 W
3 W
9 VA (class 2 power source)
1/2" to 1.05" round, centers on 1/2" and 3/4" with insert, 1.05" without insert
3 ft [1 m], 18 GA appliance cable with 1/2" conduit connector
electronic throughout 0° to 95° rotation
0 to 135 Ω Honeywell Electronic Series 90, 0 to 135 Ω input
2 to 10 VDC, 0.5 mA max, VDC variable
95° (adjustable with mechanical end stop, 35° to 95°)
90 in-lbs [10 Nm] minimum
reversible with built-in switch
reversible with CW/CCW mounting
electronic thoughout 0 to 95° rotation
5 mm hex crank (3/16" Allen), supplied
150 sec (default), variable (40 to150 sec)
<20 sec @ -4°F to 122°F [-20°C to 50°C], <
60 sec @ -22°F [-30°C]
max. 95% RH non-condensing
-22°F to 122°F [-30°C to 50°C]
-40°F to 176°F [-40°C to 80°C]
NEMA 2, IP54, UL enclosure type 2
ISO,CE,cCSAus
<50 dB (A)
<62 dB (A)
maintenance free
ISO 9001
4.4 lb [2 kg]

 $\ensuremath{\dagger}\xspace$ Rated Impulse Voltage 800V, Type of action 1.AA, Control Pollution Degree 3







Wiring Diagrams



X INSTALLATION NOTES



Provide overload protection and disconnect as required.



Actuators may also be powered by 24 VDC.



Actuators and controller must have separate transformers. Consult controller instruction data for more detailed information.



Resistor value depends on the type of controller and the number of actuators. No resistor is used for one actuator. Honeywell® resistor kits may also be used.



To reverse control rotation, use the reversing switch.



Actuators may be controlled in parallel. Current draw and input impedance must be observed.



APPLICATION NOTES



Meets cULus requirements without the need of an electrical ground connection.



WARNING! LIVE ELECTRICAL COMPONENTS!

During installation, testing, servicing and troubleshooting of this product, it may be necessary to work with live electrical components. Have a qualified licensed electrician or other individual who has been properly trained in handling live electrical components perform these tasks. Failure to follow all electrical safety precautions when exposed to live electrical components could result in death or serious injury.

