

P6250S-127-250, 2-1/2", ANSI 250 Electronic Pressure Independent Valve

Cast Iron Body, Stainless Steel Trim



Technical Data

| | |
|---|--|
| Service | chilled or hot water, up to 60% glycol max (open loop/steam not allowed) |
| Flow Characteristic | equal percentage or linear |
| Controllable Flow Range | stem up - open A to AB |
| Size [mm] | 2.5" [65] |
| End Fitting | 250 lb flanged |
| Body | cast iron - ASTM A126 Class B |
| Stem | 316 stainless steel |
| Stem Packing | NLP EPDM (no lip packing) |
| Seat | 316 stainless steel |
| Plug | stainless steel |
| Sensor Housing | ductile iron - GGG50 |
| Body Pressure Rating [psi] | ANSI 250 |
| GPM Range | 38-127 |
| Number of Bolt Holes | 8 |
| Max Inlet Pressure (Water) | 300 psi (2068 kPa) @ 250°F [121°C] |
| Media Temperature Range (Water) | 14°F to 250°F [-10°C to 120°C] |
| Conductivity of Fluid | Min. 20uS/cm |
| Differential Pressure Range | 7.5 to 50 psid or 1 to 50 psid with flow reductions |
| Max Differential Pressure (Water) | 50 psi (345 kPa) |
| Close-Off Pressure | 310 psi |
| Leakage | ANSI Class IV |
| Inlet Length to Meet Specified Measurement Accuracy | 5X nominal pipe size (NPS) |
| Flow Measurement Tolerance | ±2%* |
| Flow Control Tolerance | ±5% |
| Flow Measurement Repeatability | ±0.5% |
| Sensor Technology | electromagnetic |
| Weight | 119 lb [54 kg] |
| Manual Override | 5 mm hex crank (3/16" Allen), supplied |
| Servicing | Repack/Rebuild kits available |
| Quality Standard | ISO 9001 |

*All flow tolerances are at 68°F (20°C) & water.

Application

Water-side control of heating and cooling systems for AHUs and water coils. Equal Percentage/ Linear: heating and cooling applications.

Operation

The Electronic Pressure Independent Control Valve is a two-way valve that maintains constant flow regardless of pressure variations in the system.


Product Features

Provides constant flow regardless of pressure variations in the system. Maximizes chiller P, preventing energizing additional chillers due to low T. Simplified valve sizing and selection, no Cv calculations required.

Suitable Actuators

| | Non-Spring | Electronic Fail-Safe |
|----------------|------------|----------------------|
| P6250S-127-250 | EVX | AVKX |

Dimensions (Inches [mm])

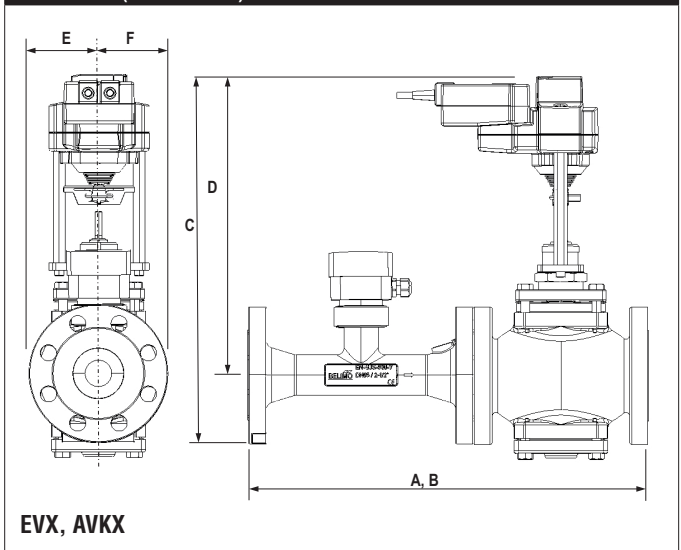


| A | B | C | D | E | F |
|-------------|---|-------------|--------------|------------|------------|
| 22.2" [564] | | 20.4" [516] | 18.25" [464] | 4.5" [114] | 4.5" [114] |

Piping

The valves should be mounted in a weather-protected area in a location that is within the ambient limits of the actuator. Allow sufficient room for valve with actuator and for service. The preferred mounting position of the valve is with the valve stem vertical above the valve body, for maximum life. However, the assemblies can be mounted with valve stem vertical above the valve or up to 45 degrees in relation to the horizontal pipe. The actuators should never be mounted underneath the valve, as condensation can build up and result in a failure of the actuators. Do not reverse flow direction.

Date created, 08/30/2017 - Subject to change. © Belimo Aircontrols (USA), Inc.

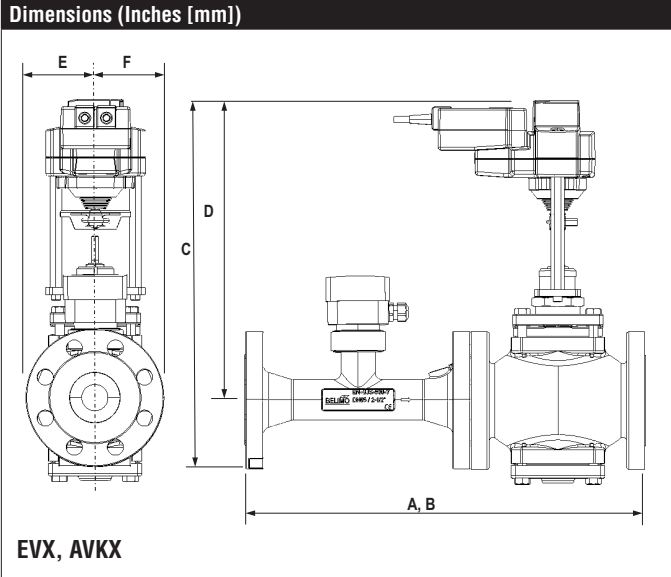

| A | B | C | D | E | F |
|-------------|---|-------------|--------------|------------|------------|
| 22.2" [564] | | 20.4" [516] | 18.25" [464] | 4.5" [114] | 4.5" [114] |

EVX24-PI-L

Modulating, Non-Spring Return, 24 V, Multi-Function Technology®



| Technical Data | |
|-------------------------------|--|
| Power Supply | 24 VAC ± 20%, 50/60 Hz, 24 VDC ± 10% |
| Power Consumption Running | 5 W |
| Power Consumption Holding | 1.5 W |
| Transformer Sizing | 7.5 VA (class 2 power source) |
| Electrical Connection | 3ft [1m], 18 GA plenum cable with 1/2" conduit connector |
| Overload Protection | electronic throughout full stroke |
| Electrical Protection | actuators are double insulated |
| Operating Range Y | 2 to 10 VDC (default) VDC variable |
| Input Impedance | 100 kΩ (0.1 mA), 500 Ω |
| Feedback Output U | 2 to 10 VDC (default) VDC variable |
| Stroke | 0.75" [19 mm] |
| Direction of Rotation (Motor) | reversible with built-in switch |
| Position Indication | stroke indicator on bracket |
| Manual Override | 5 mm hex crank (3/16" Allen), supplied |
| Running Time (Motor) | 90 sec, constant independent of load |
| Ambient Humidity | 5 to 95% RH non-condensing |
| Ambient Temperature Range | -22°F to 122°F [-30°C to 50°C] |
| Storage Temperature Range | -40°F to 176°F [-40°C to 80°C] |
| Housing | NEMA 1, IP54, UL enclosure type 1 |
| Housing Material | Aluminum die cast and plastic casing |
| Agency Listings† | cULus acc. to UL60730-1A/-2-14, CAN/CSA E60730-1:02, CE acc. to 2004/108/EC and 2006/95/EC |
| Noise Level (Motor) | <60 dB (A) |
| Servicing | maintenance free |
| Quality Standard | ISO 9001 |
| Weight | 5.7 lb [2.6 kg] |

† Use flexible metal conduit. Push the listed conduit fitting device over the actuator's cable to butt against the enclosure. Screw in conduit connector. Jacket the actuators input wiring with listed flexible conduit. Properly terminate the conduit in a suitable junction box. Rated impulse Voltage 800V. Type of action 1. Control pollution degree 3.

In cases where the valve body is electrically isolated from the water pipe, an earth ground should be installed in order for the sensor to work properly. Earth ground can be connected directly on the sensor body. A connection point is provided on the flange of the sensor body.

Date created, 08/14/2017 - Subject to change. © Belimo Aircontrols (USA), Inc.

Wiring Diagrams
INSTALLATION NOTES

- Provide overload protection and disconnect as required.
- Actuators may be connected in parallel. Power consumption and input impedance must be observed.
- Actuators may also be powered by 24 VDC.
- A 500 Ω resistor (ZG-R01) converts the 4 to 20 mA control signal to 2 to 10 VDC.
- Actuators with plenum cable do not have numbers; use color codes instead.
- Meets cULus requirements without the need of an electrical ground connection.

WARNING! LIVE ELECTRICAL COMPONENTS!
 During installation, testing, servicing and troubleshooting of this product, it may be necessary to work with live electrical components. Have a qualified licensed electrician or other individual who has been properly trained in handling live electrical components perform these tasks. Failure to follow all electrical safety precautions when exposed to live electrical components could result in death or serious injury.

