


Technical data sheet

F680HD








Technical data

Functional data	Valve Size	3" [80]	
	Fluid	chilled or hot water, up to 60% glycol	
	Fluid Temp Range (water)	-22250°F [-30120°C]	
	Body Pressure Rating	ANSI Class Consistent with 125, 232 psi CWP	
	Close-off pressure ∆ps	200 psi	
	Flow characteristic	modified equal percentage	
	Servicing	maintenance-free	
	Rangeability Sv	10:1 (for 3070° range)	
	Flow Pattern	2-way	
	Leakage rate	0%	
	Controllable flow range	90° rotation	
	Cv	302	
	Maximum Velocity	12 FPS	
	Lug threads	5/8-11 UNC	
Materials	Valve body	Ductile cast iron ASTM A536	
	Body finish	epoxy powder coating (blue RAL 5002)	
	Spindle	416 stainless steel	
	Spindle seal	EPDM (lubricated)	
	Seat	EPDM	
	Pipe connection	for use with ANSI class 125/150 flanges	
	Bearing	RPTFE	
	Disc	304 stainless steel	
	Gear operator materials	Gears - hardened steel	
Suitable actuators	Non-Spring	GRB(X)	
	Spring	(2*AFB(X))	
	Electrical fail-safe	GKRB(X)	




Product features







Dimensions

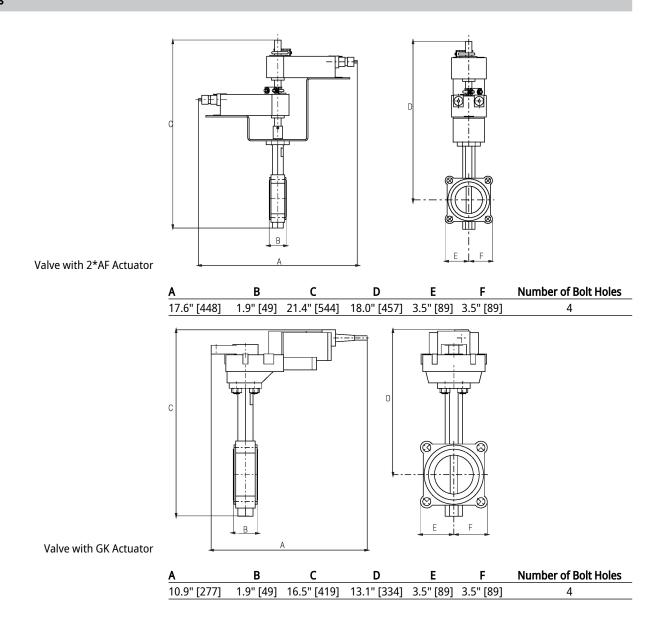




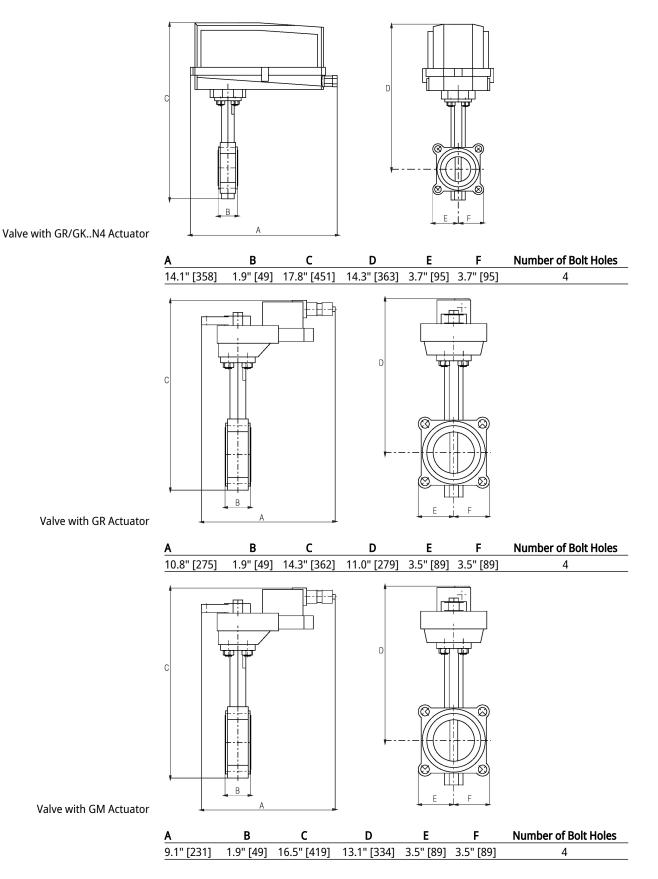



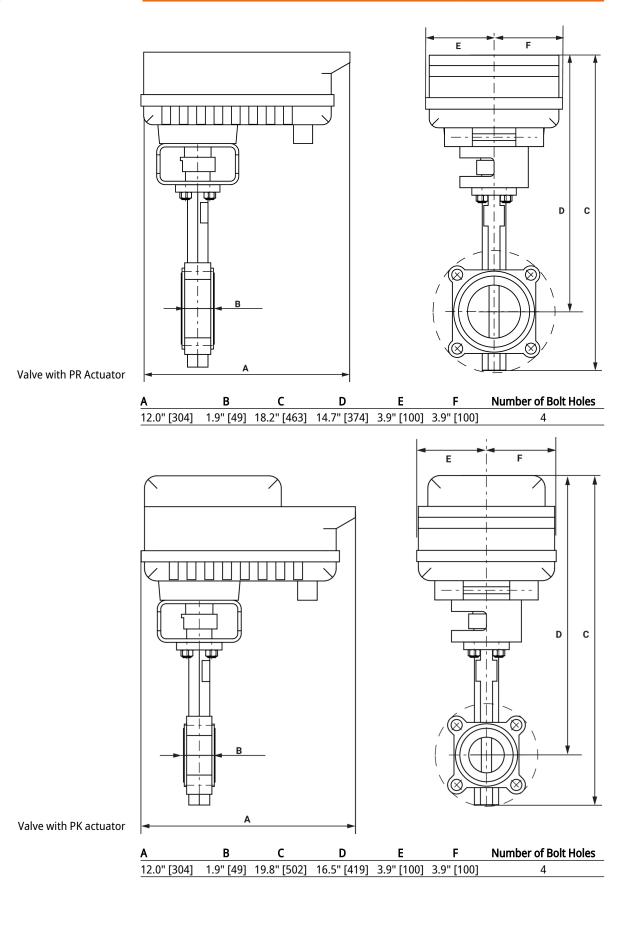



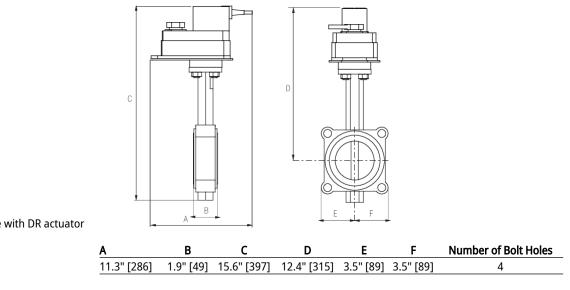

Valve with DR actuator



2...10 V or 4...20 mA Control Signal

Technical data sheet

GKRX24-MFT N4






Technical data

Electrical data	Nominal voltage	AC/DC 24 V
	Nominal voltage frequency	50/60 Hz
	Power consumption in operation	12 W
	Power consumption in rest position	3 W
	Transformer sizing	21 VA (class 2 power source) / heater 21 VA
	Electrical Connection	18 GA plenum cable, 3 ft [1 m], with 1/2" conduit connector
	Overload Protection	electronic thoughout 090° rotation
Functional data	Operating range Y	210 V
	Operating range Y note	420 mA w/ ZG-R01 (500 Ω, 1/4 W resistor)
	Input Impedance	100 k Ω for 210 V (0.1 mA), 500 Ω for 420 mA, 1500 Ω for PWM, On/Off and Floating point
	Operating range Y variable	Start point 0.530 V End point 2.532 V
	Options positioning signal	variable (VDC, on/off, floating point)
	Position feedback U	210 V
	Position feedback U note	Max. 0.5 mA
	Position feedback U variable	VDC variable
	Bridging time (PF)	2 s
	Bridging time (PF) variable	010 s
	Pre-charging time	520 s
	Direction of motion motor	selectable with switch 0/1
	Direction of motion fail-safe	reversible with switch
	Manual override	under cover
	Angle of rotation	Max. 95°
	Angle of rotation note	adjustable with mechanical stop
	Running Time (Motor)	150 s / 90°
	Running time motor variable	90150 s
	Running time fail-safe	<35 s
	Noise level, motor	52 dB(A)
	Noise level, fail-safe	61 dB(A)
	Position indication	Mechanically, 3065 mm stroke
Safety data	Degree of protection IEC/EN	IP66/67
	Degree of protection NEMA/UL	NEMA 4X
	Enclosure	UL Enclosure Type 4X
	Agency Listing	cULus acc. to UL60730-1A/-2-14, CAN/CSA E60730-1:02, CE acc. to 2014/30/EU and 2014/35/EU
	Quality Standard	ISO 9001

BELIMO	Technical data sheet	GKRX24-MFT N4		
Safety data	Ambient temperature -22122°F [-30.	50°C]		
	Ambient temperature note -4050°C for ac	tuator with integrated heating		
	Storage temperature -40176°F [-40.	80°C]		
	Ambient humidity Max. 100% RH			
	Servicing maintenance-free	ee		
Materials	Housing material Die cast alumini	Die cast aluminium and plastic casing		
Footnotes	†Rated Impulse Voltage 800V, Type of action 1.AA, Control Pollution Degree 3			
Product features				
Bridging time	lectrical interruptions can be bridged up to a maximum of 10 s.			
	In the event of a power failure, the actuator will remain stationary in accordance with the set bridging time. If the power failure is greater than the set bridging time, then the actuator will move into the selected fail-safe position.			
	The bridging time set ex-works is 2 s. This can be modified on site in operation with the use of the Belimo service tool MFT-P.			
	Settings: The rotary knob must not be set to the "PROG FAIL-SAFE" position!			
	For retroactive adjustments of the bridging time with the Belimo service tool MFT-P or with the ZTH EU adjustment and diagnostic device only the values need to be entered.			
Accessories				
Gateways	Description	Туре		
	Gateway MP to BACnet MS/TP	UK24BAC		
	Gateway MP to Modbus RTU Gateway MP to LonWorks	UK24MOD UK24LON		
Electrical accessories	Description			
	Feedback potentiometer 140 Ω add-on, grey	Type P140A GR		
	Feedback potentionieter 140 Ω add-on, grey	P500A GR		
	Feedback potentiometer 1 k Ω add-on, grey	P1000A GR		
	Feedback potentiometer 2.8 k Ω add-on, grey	P2800A GR		
	Feedback potentiometer 5 k Ω add-on, grey	P5000A GR		
	Feedback potentiometer 10 k Ω add-on, grey	P10000A GR		
	Auxiliary switch 1 x SPDT add-on	S1A S2A		
	Auxiliary switch 2 x SPDT add-on Service Tool, with ZIP-USB function, for programmable and	ZTH US		
	communicative Belimo actuators, VAV controller and HVAC perfo devices			
Service tools	Description	Туре		
	Connection cable 10 ft [3 m], A: RJ11 6/4 ZTH EU, B: 3-pin Weidm supply connection			
	Service Tool, with ZIP-USB function, for programmable and communicative Belimo actuators, VAV controller and HVAC perfo devices	ZTH US prmance		
Electrical installation				
(A) Actuators with appliance cables are numbered.				
A Actuators with appliance cables are numbered. Provide overload protection and disconnect as required.				
Actuators may also be powered by DC 24 V.				
	Only connect common to negative (-) leg of control circuits.			
-	A 500 Ω resistor (ZG-R01) converts the 420 mA control signal to	o 210 V.		
	Control signal may be pulsed from either the Hot (Source) or Co			



Technical data sheet



🛕 IN4004 or IN4007 diode. (IN4007 supplied, Belimo part number 40155).

 $\frac{1}{16}$ Actuators are provided with a numbered screw terminal strip instead of a cable.

 ${}_{
m A}$ Actuators may be controlled in parallel. Current draw and input impedance must be observed.

A Master-Slave wiring required for piggy-back applications. Feedback from Master to control input(s) of Slave(s).

Meets cULus requirements without the need of an electrical ground connection.

Warning! Live electrical components!

During installation, testing, servicing and troubleshooting of this product, it may be necessary to work with live electrical components. Have a qualified licensed electrician or other individual who has been properly trained in handling live electrical components perform these tasks. Failure to follow all electrical safety precautions when exposed to live electrical components could result in death or serious injury.

