SpaceLogic MA/F/S 51-710x

Series

35 lb-in. Spring Return Actuators

Application

Linear **SpaceLogic** Actuators are designed to mount directly onto two-way or three-way globe valves without the use of linkages. They provide linear travel to operate valves from 1/2" to 2" VB-7xxx and discontinued 1/2" to 1-1/4" VB-9xxx in chilled water, hot water and steam applications up to 366 °F (186 °C). Linear spring return actuators provide either two position, floating or proportional modulation control (depending on model selection) of valves in HVAC systems.

Specifications

| Actuator Inputs | |
|--------------------|--|
| Control Signal | See Table-1 for actuator models |
| | and control type |
| Power Input | See Table-1. All 24 Vac circuits are Class 2 |
| | All circuits 30 VAC and above are Class 1 |
| Connections | 3 ft (91 cm) appliance wire or |
| | plenum cables, enclosure |
| | accepts 1/2" (13 mm) conduit |
| | connectors. For M20 Metric connector, |
| | use AM-756 adaptor. |
| A atriatar Outputa | |

Actuator Outputs Electrical

Position Feedback Voltage (proportional or floating only):


For voltage ranges, the feedback signal is the same range as the input signal. The 4...20 mAdc current range and floating actuators have a 2...10 Vdc position feedback signal. The position feedback signal can supply up to 0.5 mAdc to operate up to four additional slave actuators

Mechanical
Linear Stroke 1/2" (13 mm) nominal
Approx. Stroke Timing See Table-1
Manual Override Allows positioning of valve and
preload using manual crank
Right/Left Jumper Permits reverse acting/direct
acting linear motion (MS51 only).

Environmental
Ambient Temperature Limits
Shipping & Storage
Operating
Temperature Restrictions

For maximum ambient 140 °F (-40...71 °C)
Temperature Restrictions

For maximum ambient 140 °F (60 °C)
the maximum allowable
fluid temperature should not exceed
valve rating. See F-27252
Selection Guide for specific ratings



Features

- Two position models controlled by SPST controller
- Floating models controlled by SPDT floating controllers
- Proportional models controlled by 0...3 Vdc, 6...9 Vdc, 0...10 Vdc, 0-20 mAdc, 2...10 Vdc, or 4...20 mAdc.
 Control function direct/reverse action is jumper selectable
- 105 lb force (467 newton) with 1/2" (13 mm) nominal linear stroke
- 24 Vac, 120 Vac, and 230 Vac models
- Rugged polymer housings rated for up to NEMA 2/IP54
- Overload protection throughout stroke
- Automatically sets input span to match valve travel
- Compact size to allow installation in limited space
- Manual override to allow positioning of valve and preload
- Spring return operation
- Direct mount to valves without separate linkage
- Polymer housing rated for plenum use
- Five year warranty

Enclosure Rating

| | plenum rated), UL Type 2 (IEC IP54) |
|--------------------|---|
| | with customer supplied water |
| | tight conduit connectors |
| Agency Listings | |
| UL | 873 Underwriters Laboratories |
| | File #E9429 Category Temperature- |
| | Indicating and Regulating Equipment |
| CUL | UL Listed for use in Canada |
| | by Underwriters Laboratories |
| | Canadian Standards C22.2 No. 24-93 |
| European Community | EMC Directive (89/336/EEC). |
| | Low Voltage Directive (72/23/EEC |
| Australia | This product meets requirements to bear the |
| | RCM mark according to the |
| | terms specified by the |

NEMA 1. NEMA 2 (enclosure is air

Communications Authority under

the Radio Communications Act 1992

Note: All performance specifications are nominal and conform to acceptable industry standards. For applications at conditions beyond these specifications, consult Schneider Electric. Schneider Electric shall not be liable for damages resulting from misapplication or misuse of its products.

www.schneider-electric.com

Humidity



5...95% RH, non-condensing.

Applicable Literature

| F-Number | Description | Audience | Purpose |
|----------|--|---|---|
| F-26080 | EN-205 Water System Guidelines | Application Engineers Installers Service Personnel Start-up Technicians | Describes Schneider Electric approved water treatment practices. |
| F-27252 | Vx-7xxx-8xx Series Vx-7xxx-59x Series Vx-9xxx-8xx Series Vx-9xxx-59x Series Selection Guide | Sales Personnel Application Engineers Installers Service Personnel Start-up Technicians | Provides Mxx1-720x and Mx51-710x actuator, valve, and valve assembly selection data including specifications, close-off pressures, and dimensional information. |
| F-26895 | AM-703 Input Scaling Module, AM-704 Pulse Width Modulation Interface, AM-705 Positioner, AM-706 Positioner, AM-708 Resistor | Installers Service Personnel | Provides step-by-step mounting instructions |
| F-27175 | AM-756 Metric Conduit Adapter, AM-763 Hexcrank, AM-770 Replacement Valve Linkage Parts Kit | Start-up Technicians | Provides step-by-step mounting instructions |
| F-27382 | TAC Electric/Electronic Products Catalog | Sales Personnel Application Engineers | Comprehensive catalog containing TAC's electric/electronic actuators, thermostats, controllers, sensors, transmitters, and accessories |

Table-1. Specifications

| Part Number | | Actuator Power Input | | | | | Approximate Stroke | | |
|------------------------------|-----------------------|--------------------------|----------------|---------------------|-----|------|---------------------|--------------------------------|--------|
| | Control Signal | | Wiring System | Running 50/60 Hz | | | Holding 50/60 Hz | Timing in Seconds @ 70F (21°C) | |
| | 2 2 3 3 2 3 3 3 3 3 3 | Voltage | | | | DC | | | Spring |
| | | | | VA | W | Amps | W | Powered | Return |
| MA51-7103-000 | | 24 Vac ±20% | Appliance Wire | 5.3 | 4.1 | 0.15 | 1.2 | 44 19 | |
| MA51-7103-100 | | 2030 Vdc | Plenum Cable | 5.3 | 4.1 | 0.15 | 1.2 | | |
| MA51-7100-000 | Two Position SPST | 120 Vac ±10% 50/60 Hz | Appliance Wire | 7.9 | 6.2 | n/a | 2.1 | | 19 |
| MA51-7101-000 | | 230 Vac ±10% 50/60 Hz | Appliance Wire | 7.4 | 5.4 | n/a | 2.1 | | |
| MF51-7103-000 | | | Appliance Wire | 6.9 | 4.7 | 0.16 | 2.1 | 60 | 16 |
| MF51-7103-100 | Floating | | Plenum Cable | 6.9 | 4.7 | 0.16 | 2.1 | | |
| MS51-7103-000 | | | Appliance Wire | 6.6 | 4.2 | 0.14 | 1.5 | | |
| MS51-7103-100b | 210 Vdc Proportional | | Plenum Cable | 6.6 | 4.2 | 0.14 | 1.5 | | |
| MS51-7103-020b | | | Appliance Wire | 6.6 | 4.2 | 0.14 | 1.5 | | |
| MS51-7103-120b | 03 Vdc Proportional | | Plenum Cable | 6.6 | 4.2 | 0.14 | 1.5 | | |
| MS51-7103-030b | | 24 Vac ±20% | Appliance Wire | 6.6 | 4.2 | 0.14 | 1.5 | | |
| MS51-7103-130b | | 2030 Vdc | Plenum Cable | 6.6 | 4.2 | 0.14 | 1.5 | | |
| MS51-7103-040b | 69 Vdc Proportional | | Appliance Wire | 7.8 | 4.9 | 0.16 | 3.4 | | |
| MS51-7103-140 ^{b d} | | | Plenum Cable | 7.8 | 4.9 | 0.16 | 3.4 | | |
| MS51-7103-050b | 0 401/4 5 17 1 | | Appliance Wire | 6.6 | 4.2 | 0.14 | 1.5 | | |
| MS51-7103-150b | 010 Vdc Proportional | | Plenum Cable | 6.6 | 4.2 | 0.14 | 1.5 | | |
| MS51-7103-060b | 4 00 44 | | | 6.6 | 4.2 | 0.14 | 1.5 | | |
| MS51-7103-160 ^b | 420 mAdc | | Plenum Cable | 6.6 | 4.2 | 0.14 | 1.5 | 1 | |

a - Timing was measured with the actuator mounted on a VB-7xxx Series valve.

Globe Valve Close-Off Pressures

For close-off pressure ratings on globe valve assemblies, consult Linked Globe Valve Assemblies with **SpaceLogic** Linear Series Actuators Selection Guide F-27252

b - Proportional (MS) models shipped with RA/DA jumper set for DA (actuator extends with increasing signal).

c - 4...20 mAdc with AM-708 500 ohm field-installed resistor.

d - Has 20 Vdc power supply for System 8000 applications.

Accessories

AM-756 Metric Conduit Adapter M20 x 1.5 to 1/2" NPT

AM-770 Replacement valve linkage parts kit

AM-764 Linkage kit for damper applications

MS51-7103

AM-703 Input rescaling module, adjust signals to 2...10 Vac, zero and span adjust

AM-704 Interface, pulse width modulation (PWM)

AM-705 Positioner (NEMA 4 housing)

AM-706 Min and/or manual positioner for flush panel mount

AM-708 500 ohm resistor for 4 to 20 mA control signal

Typical Two Position Control (Wiring Diagrams)

Figure-1 illustrates typical wiring diagrams for spring return two-position MA51-710x actuators. See Table-1 for model selection. See 8 for wiring diagrams notes guide.

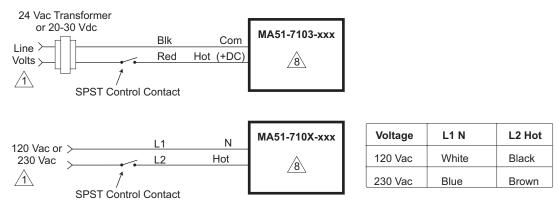


Figure-1. Typical Wiring Diagrams for Two Position Actuators

Typical Floating Control (Wiring Diagrams)

Figure-2 through Figure-5 illustrates typical wiring diagrams for spring return floating MF51-7103 actuators. See Table-1 for model selection. See 8 for wiring diagrams notes guide.



Caution

• This product contains a half-wave rectifier power supply and must not be powered off transformers used to power other devices utilizing non-isolated full-wave rectifier power supplies. Refer to EN-206, Guidelines for Power Multiple Devices from a Common Transformer, F-26363 for detailed information.

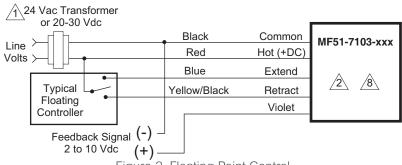


Figure-2. Floating Point Control

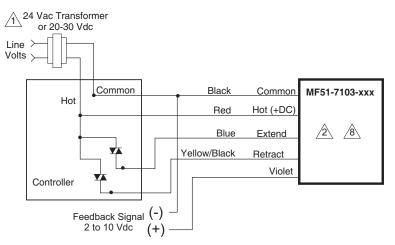


Figure-3. Triac Source

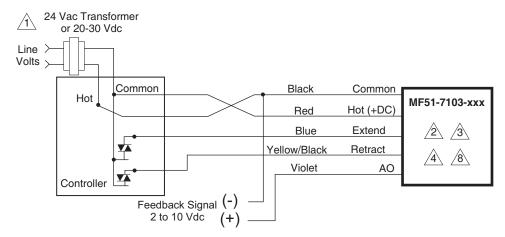


Figure-4 Triac Sink

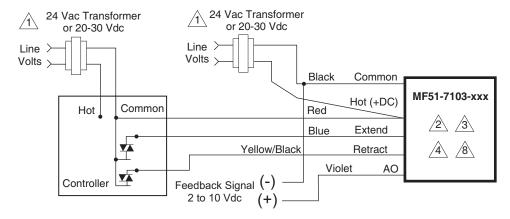


Figure-5 Triac Sink With Separate Transformers

Typical Proportional Control (Wiring Diagrams)

Figure-6 illustrates typical wiring diagrams for spring return proportional MS51-7103 actuators. See Table-1 for model selection. See 8 for wiring diagrams notes guide.



Caution

This product contains a half-wave rectifier power supply and must not be powered off transformers used to power other
devices utilizing non-isolated full-wave rectifier power supplies. Refer to EN-206, Guidelines for Powering Multiple Devices
from a Common Transformer, F-26363 for detailed information.

4 to 20 mAdc with 2-10 Vdc Actuators **Vdc Proportional Control** 24 Vac Transformer 24 Vac Transformer or 20-30 Vdc or 20- 30 Vdc Blk Blk Com MS51-7103-xxx Com MS51-7103-x00 Line > Line Red Hot (+DC) Red Hot (+DC) Volts > Volts > Yel/Blk 4 ΑI 500 Ω 7 /5 4 Violet ΑO Control Signal (-) Vdc or mAdc Yel/Blk 8 ΑI 4 to 20 mAdc (+) Control Signal /8\ Violet ΑO (-)Vdc Feedback Signal Feedback Signal (+) 2 to 10 Vdc To Additional 2-10 Vdc Actuators

Figure-6 Typical Wiring Diagrams for Proportional Control 24 Vac Basic Models

Installation

Inspection

Inspect the package for damage. If damaged, notify the appropriate carrier immediately. If undamaged, open the package and inspect the device for obvious damage. Return damaged products.

Requirements

- Job wiring diagrams
- Appropriate accessories
- Pliers for removing and inserting connecting pin
- Installer must be a qualified, experienced technician
- TOOL-37, 1 5/8" open end wrench for valve mounting nut
- 5/16" and 7/16" open-end wrench for stem jam nuts and stem extension
- #8 Torx screwdriver (not provided)

Precautions



Warnina:

- Electrical shock hazard! Disconnect the power supply (line power) before installation to prevent electric shock and equipment damage.
- Make all connections in accordance with the job wiring diagram and in accordance with national and local electrical codes. Use copper conductors only.
- Floating and Proportional Models: These products contain a half-wave rectifier power supply. They must not be powered with transformers that are used to power other devices utilizing non-isolated full-wave rectifier power

supplies. Refer to EN-206, Guidelines For Powering Devices From A Common Transformer, F-26363 for detailed information.



Caution

- Avoid electrical noise interference. Do not install near large contactors, electrical machinery, or welding equipment.
- Manual override to be used only when power is not applied to unit.
- When operating manual override (observe position indicator), back off 5° from full extended mechanical stop to ensure proper release.
- Use with fluid temperatures above 100°C requires insulation on the pipe and control valve.

Federal Communications Commission (FCC)

Note: This equipment has been tested and found to comply with the limits for a Class B digital device, pursuant to Part 15 of the FCC Rules. These limits are designed to provide reasonable protection against harmful interference in residential installations. This equipment generates, uses, and can radiate radio frequency energy and may cause harmful interference if not installed and used in accordance with the instructions. Even when instructions are followed, there is no guarantee that interference will not occur in a particular setting—which can be determined by turning the equipment off and on—the user is encouraged to try to correct the interference by one or more of the following measures:

- Reorient or relocate the receiving antenna.
- Increase the separation between the equipment and receiver.

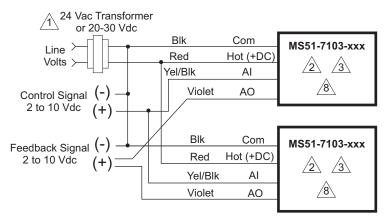


Figure-7a Typical Wiring Diagrams for Proportional Control 24 Vac Models Wired in Parallel

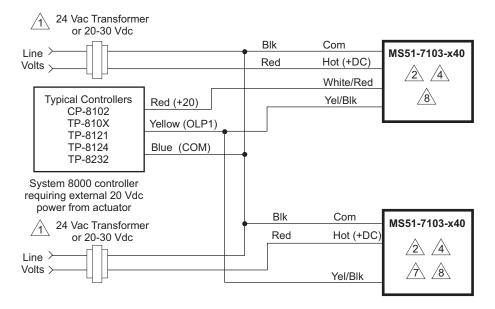


Figure-7b Typical Control Wiring for Two MS51-7103-x40 to System 8000 Controllers Requiring External 20 Vdc Power from Actuator

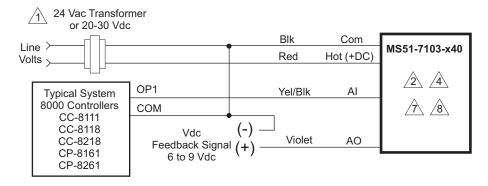


Figure-7c Typical Control Wiring for MS51-7103-x40 to Controllers not Requiring External 20 Vdc Power from Actuator

schneider-electric.com | 7

Provide overload protection and disconnect as required.

Actuators may be wired (120V mA does not have red wire and 230V mA does not have red or black wires) in parallel. All actuator black wires are connected to the transformer common and all red wires are connected to the hot lead. Power consumption must be observed.



3\ The Common connection from the actuator must be connected to the Hot connection of the controller. The actuator Hot must be connected to the controller



4\ If the controller uses a full-wave power supply and does not provide isolated outputs, a separate transformer is required.

A field-supplied 500 ohm resistor (AM-708) is required for this application.

On MS51-7103-X60 (4-20 mAdc) models a 500 ohm resister is incorporated in the product. Do not use an external resistor.

If using multiple MS51-7103-040's with TAC System 8000 controller requiring 20 Vdc power; tape off red +20 Vdc power supply leads on all but one actuator.



Cable on some models contains more wires than are used in applications. Only those wires actually used are shown.

Figure-8 Wire Diagram Notes Guide

- Connect the equipment to an outlet on a circuit different from that to which the receiver is connected.
- Consult the dealer or an experienced radio/television technician for help.

Canadian Department of Communications (DOC)

Note: This Class B digital apparatus meets all requirements of the Canadian Interference-Causing Equipment Regulations.

Cet appareil numerique de la classe B respecte toutes les exigences du Reglement sur le material broilleur du Canada.

European Standard EN 55022

Warning: This is a Class B digital (European Classification) product. In a domestic environment this product may cause radio interference in which case the user may be required to take adequate measures.

Location



Caution

Avoid locations where excessive moisture, corrosive fumes, vibration, or explosive vapors are present.

Mounting

- Mount the linear actuator directly on the valve in locations that clear the maximum dimensions of the actuator case (see Figure-12).
- Ensure that the valve body is installed correctly. The arrow must point in the direction of flow. With three-way valves observe stem position (stem up or stem down) for proper flow characteristics. See Table 3.
- It is preferable that the actuator is mounted above the valve body. This will minimize the risk of damage to the actuator in the event of condensation or a valve leak. Refer to Figure-10.

Changing Control Function (proportional units only)

These actuators are equipped with a jumper to control the function of the signal as received. See Figure-9. Factory setting is for direct acting. Remove cover to change jumper setting.

Installation

Mx51-710x Series Actuator to 1/2" to 2" VB-7xxx Series Valve Bodies, 2-Way Stem-Up Closed and 3-Way Mixing or Diverting Applications

- Preload the valve to insure proper close-off according to the numbered steps in Figure-10 and the text below. (Remove power before proceeding.)
 - a. Locate the steel jam nut that came packaged with the actuator. (Do not re-use the brass jam nut present on an existing valve.)
 - b. Screw the nut onto the valve stem all the way as far as it will go (you may need to use a TOOL-20-1 or a 5/16" open-end wrench). At least 1/2" of the valve stem should extend above the nut.
 - c. Thread the stem extension onto the valve stem, making contact with the jam nut. Raise the valve stem to the full up position.
 - d. Orient the actuator mounting bracket on the valve and tighten the hex mounting nut securely against the bracket using TOOL-37.
 - e. Insert the crank provided in the actuator cover. Wind two turns counterclockwise. Press in the turn crank 1/8 turn counterclockwise to lock in position.
 - Rotate the stem extension until the through holes in the stem extension and rack line up. Insert connecting pin to secure stem extension and tighten jam nut against stem extension using TOOL-20-1 or a 5I16" open end wrench.
 - g. Apply power to the actuator and check the system operation for heating or cooling output in response to the control signal.

Mx51-710x Series Actuator to 1/2" to 2" VB-7xxx Series Valve Bodies, 2-Way Stem-Up Open

- Preload the valve to insure proper close-off according to the numbered steps to 10 and the text below. (Remove power before proceeding.)
 - a. Locate the steel jam nut that came packaged with the actuator. (Do not re-use the brass jam nut present on an existing valve.)
 - b. Screw the nut onto the valve stem as far as pos-

sible (use TOOL-20-1 or a 5/16" open-end wrench if needed). At least 1/2" of the valve stem should extend above the nut.

- c. Thread the stem extension onto the valve stem, making contact with the jam nut. Push the valve stem to the full down position.
- d. Orient the actuator mounting bracket on the valve and tighten the hex mounting nut securely against the bracket using TOOL-37.
- e. Insert the crank provided in the actuator cover. Wind the crank counterclockwise until the actuator fully extends, then unwind 2 turns and press in and turn crank 1/8 turn counterclockwise to lock in position.
- f. Rotate the stem extension until the through holes in the stem extension and rack lineup. Insert connecting pin to secure stem extension and tighten jam nut against stem extension using TOOL-20-1 or a 5I16" open end wrench.
- 7. Apply power to the actuator and check the system operation for heating or cooling output in response to the control signal.

Valve Mounting

The valve should be mounted in a weather-protected area, in a location that is within the ambient temperature limits of the actuator. The installation of the actuator assembly should provide clearance on all sides to allow for any maintenance that may be needed (see Figure-10 and Figure-11).

- 1. Following general piping practices is recommended.
- 2. Apply pipe sealant sparingly to all but the last two threads of a properly threaded, reamed, and cleaned pipe. Make sure the pipe chips, scale, etc. do not get into the pipe since this material may lodge in the valve seat and prevent proper closing and opening of the valve. The valve must be piped with an inlet and an outlet.
- 3. Start the joint hand-threading the pipe into the valve. If the thread alignment feels normal, continue to turn the pipe by hand as far as it will go.
- 4. Use a pipe wrench to fully tighten the pipe to the valve.

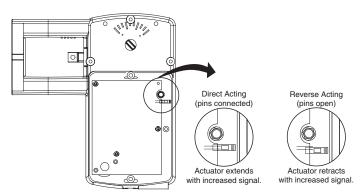


Figure-9 RA/DA Jumper Setting for Proportional Models



Caution

- Do not over-tighten the pipe, which may cause stripped threads. Avoid twisting or crushing the valve while tightening the pipe.
- Insulate only the valve body and associated piping, not the actuator.
- In chilled or cold water systems where the environment is humid, use a drip pan under the valve to catch condensate.



Caution

- The **SpaceLogic** linear actuator is designed to effectively support its own weight. No load or weight should be resting on the actuator, long term damage may occur to the actuator, mounting connection or the valve.
- Do not insulate the actuator/linkage. Doing so will result in excess heat buildup within the actuator.
- For non-steam application the globe valve assembly must be mounted so that the actuator is at least 5° above the horizontal (Figure-11) to ensure that any condensate that forms will not travel into the mounting bracket or actuator.
- On steam applications, the globe valve assembly must be mounted approximately 45° from horizontal.
- Temperature Restrictions: For maximum ambient 140 °F (60 °C) the maximum allowable fluid temperature should not exceed valve rating. See F-27252 Selection Guide for specific ratings.

Manual Override Operation

When necessary, the actuator's output shaft can be repositioned using the manual override mechanism as follows:

- Disconnect power from the actuator. The actuator will fully retract.
- Without pushing down on the crank, crank the manual override counterclockwise until the actuator extends to the desired position. Push in until the mechanism locks in position. (The manual override lock will release the next time power is applied.)

If you desire to reposition the actuator manually from a locked position, turn the crank 1/8 turn counterclockwise and pull out to release. Adjust position as desired.



Caution

- Only use manual override when the actuator drive motor is not powered.
- Engaging the manual override when the actuator is powered may cause damage to the gears.
- Using power tools to adjust the override will cause damage to the gears.

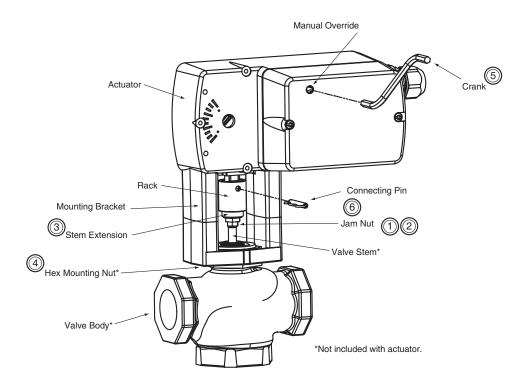


Figure-10 Mx51-710x Series Actuator Exploded View

Wiring Requirements

Control Leads

See Table-2 for power wiring data. Refer to Figure-1 through Figure-7 for typical wiring.

Table-2. Power Wiring

| | Part Number | Maximum Wire Run in ft. (m) | | | | | | |
|-----------------------|----------------|-----------------------------|---------------|--------------|--------------|-------------|-------------|--|
| Actuator Voltage | | 12 AWG | 14 AWG | 16 AWG | 18 AWG | 20 AWG | 22 AWG | |
| 24 Vac 2030 Vdc | MA51-7103 | 1678 (512) | 1055 (322) | 664 (202) | 417 (127) | 263 (80) | 208 (63) | |
| | MF51-7103 | 1289 (393) | 810 (247) | 510 (155) | 321 (98) | 202 (61) | 160 (49) | |
| | MS51-7103 | 1140 (348) | 717 (219) | 451 (137) | 284 (86) | 178 (54) | 141 (43) | |

Checkout

After the entire system has been installed and the actuator has been powered up, the following check can be made for proper system operation. Check for correct operation of the valve while actuator is being stroked.

- Apply power to the actuator. Actuator and valve should be driven to their powered position as determined by the control signal. Refer to Table-3 for valve flow.
- 2. Break power to the actuator. Actuator and valve should return to the spring return position (retracted position). Note: Check that the transformer(s) are sized properly.
- If a common transformer is used with multiple actuators, make sure that polarity is observed on the secondary.

This means connecting all black wires to one leg of the transformer and all red wires to the other leg of the transformer.

- If multiple transformers are used with one control signal, make sure all black wires are tied together and tied to control signal negative (-).
- If the controller uses a full-wave power supply and does not provide isolated outputs, a separate transformer is required.

Theory of Operation

The MA, MF and MS series actuators are directly mounted onto the valve without the use of a separate linkage. They are equipped with true mechanical spring return operation for reliable, positive close-off on valves. When power is applied, the actuator moves to its powered position, at the same time tensing the spring return safety mechanism. When the power is removed, the spring returns the actuator to its normal position (retracted position). The spring return system provides consistent close-off force to the valve.

MA series two-position actuators use a DC motor controlled by on board electronics. When the actuator encounters a stall or end of travel position, the motor current is automatically reduced, preventing damage to the actuator or motor.

MF or MS series floating or proportional actuators use a DC motor which is controlled by a microprocessor. The microprocessor supplies the intelligence to provide a constant speed and to know the actuator's exact position. The microprocessor monitors and controls the DC motor's rotation and provides a digital rotation sensing function to prevent damage to the actuator in a stall condition.

All actuators may be stalled anywhere in their normal rotation without the need of a mechanical end switch.

Maintenance

Regular maintenance of the total system is recommended to assure sustained optimum performance. The Linear series actuators are maintenance free.

Field Repair

None. Replace with a functional actuator.

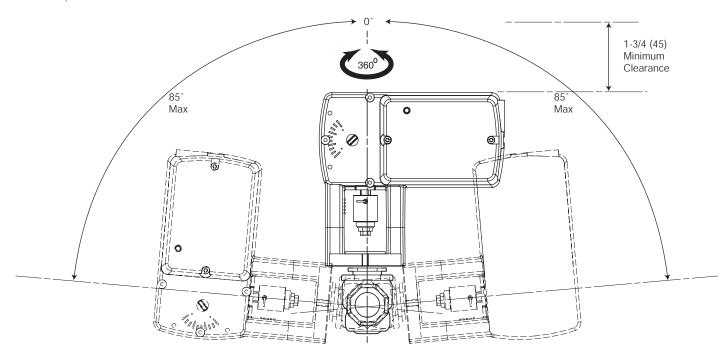


Figure-11 Acceptable Mounting Orientations for Non-Steam Applications

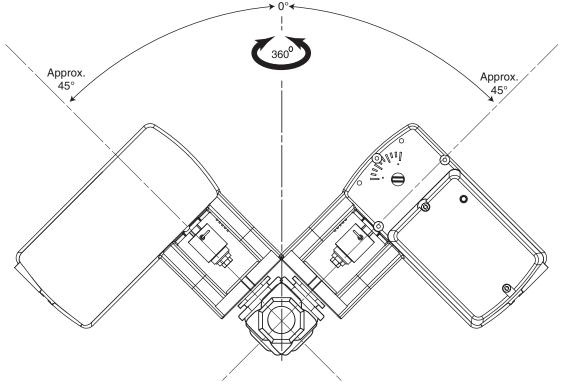


Figure-12 Acceptable Mounting Orientation for Steam Applications

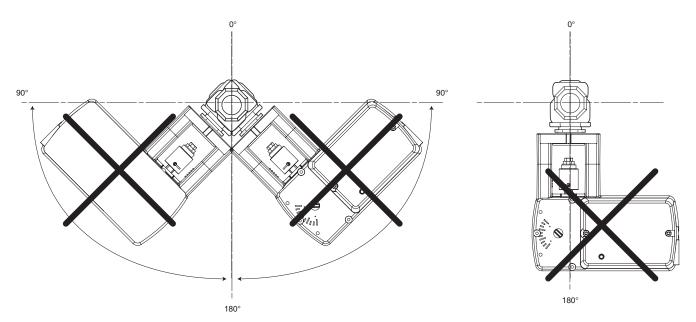



Figure -13 Unacceptable Mounting Orientation

Dimensional Data

Table-3. Assembly Configuration Chart

| Value De de | Valve Body Action | Normal Position | | Action ^a | |
|---------------------------------|------------------------|-----------------|---------|---|--|
| Valve Body | | Valve Stem | Flow | | |
| VB-721x VB-921x | Two-Way Stem Up Open | Up | Open | A to AB flow decreases as actuator extends | |
| VB-722x VB-922x ^b | Two-Way Stem Up Closed | Up | Closed | A to AB flow increases as actuator extends | |
| VB-731x VB-931x ^b | Three-Way Mixing | Up | B to AB | A to AB flow increases as actuator extends B to AB flow decreases as actuator extends | |
| VB-732x VB-932x ^b | Three-Way Diverting | Up | B to AB | B to A flow increases as actuator extends B to AB flow decreases as actuator extends | |

- a- Proportional models shipped with RA/DA jumper set for DA (actuator extends with increasing signal). b- Discontinued 1/2" to 1-1/4" VB-9xxx.

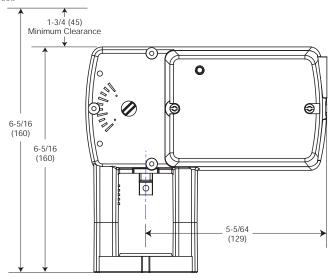

Dimensions shown are in inches (mm).

Figure-14 Mx51-710x Spring Return Valve Actuator Dimensions

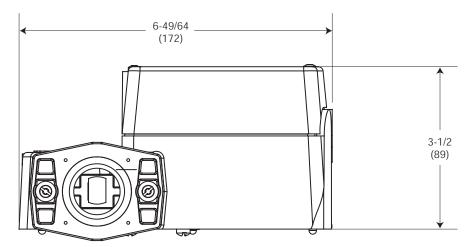


Figure-15 Mx51-710x Spring Return Valve Actuator Dimensions

| Commercial Reference | Range | Brand | | | | |
|--|--------|--|--------|---------------|---------------------------------------|-----------------|
| MA51-71XX MS51-71XX MF51-71XX | LIN | SpaceLogic LINEAR ACTUATORS MA51 2-POSITION LINEAR 105-INLBF SPRING RETURN MS51 PROPORTIONAL LINEAR 105-INLBF SPRING-RETURN MF51 FLOATING LINEAR 105-INLBF SPRING-RETURN | | | LINEAR 105-INLBF IG LINEAR 105-IN- | 20) |
| | | | 有害 | | | |
| 部件名称 Part Name | 铅 (Pb) | 汞 (Hg) | 镉 (Cd) | 六价铬 (Cr (VI)) | 多溴联苯 (PBB) | 多溴二苯醚 (PBDE) |
| 属部件 Metal Parts | Х | 0 | 0 | 0 | 0 | 0 |
| 塑料部件 Plastic Parts | 0 | 0 | 0 | 0 | 0 | 0 |
| 电子件 Electronic | Х | 0 | 0 | 0 | 0 | 0 |
| 线缆和线缆附件 Cables & cabling ac- cessories | 0 | 0 | 0 | 0 | 0 | 0 |

本表格依据 SJ/T11364 的规定编制。

- O: 表示该有害物质在该部件所有均质材料中的含量均在 GB/T 26572 规定的限量要求以下。
- X:表示该有害物质至少在该部件的某一均质材料中的含量超出 GB/T 26572 规定的限量要求。
- (企业可在此处,根据实际情况对上表中打 "X" 的技术原因进行进一步说明。)

This table is made according to SJ/T 11364.

- O: indicates that the concentration of hazardous substance in all of the homogeneous materials for this part is below the limit as stipulated in GB/T 26572.
- X: indicates that concentration of hazardous substance in at least one of the homogeneous materials used for this part is above the limit as stipulated in GB/T 26572